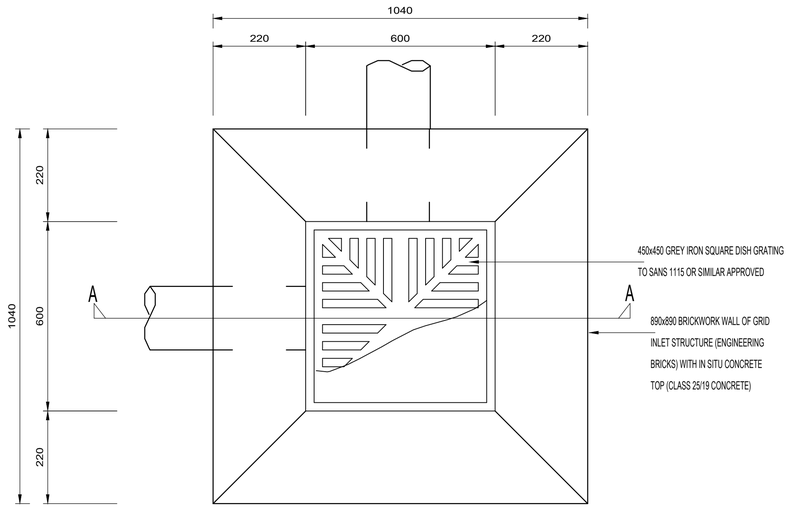

GRID INLET PLAN

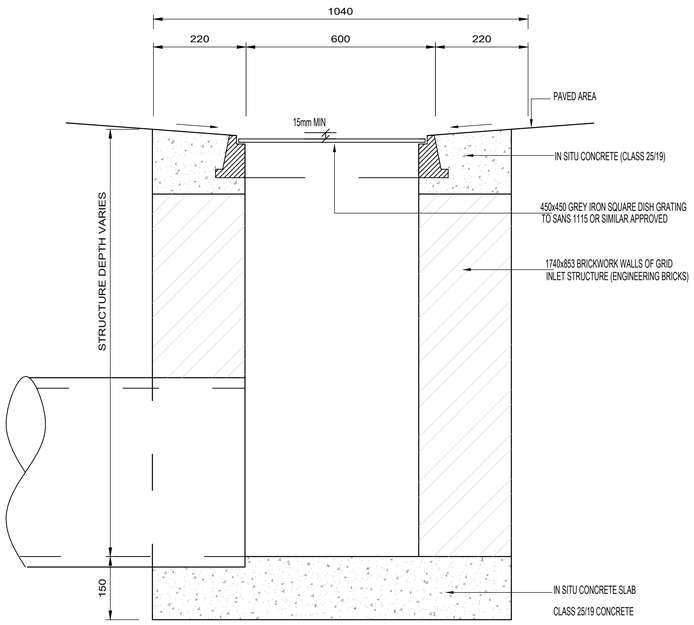

SECTION A-A

GRID INLET (GI) DETAIL

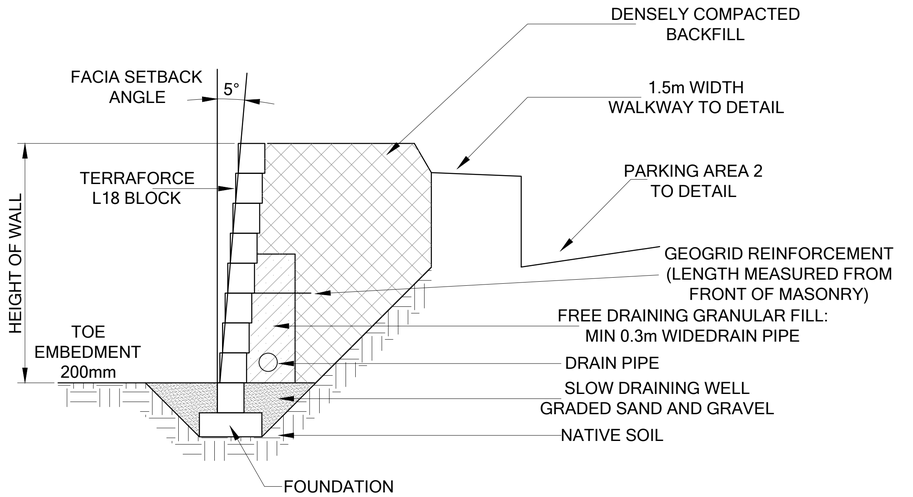

DETAIL 1 - EARTH BERM DETAIL

SCALE 1: 50

GENERAL NOTES:

Stormwater

1. Minimum pipe diameter to be 450mm.
2. Maximum angle between adjoining pipes is 60 degrees.
3. All bricks shall comply with SABS 227 and shall be engineering units of class FBS (face brick standard).

TENDER

REV.	DATE	DESCRIPTION	BY
TD	06/04/2021	ISSUED FOR TENDER	NM

REVISIONS

CONSULTANT:
ADi (PTY)LTD
BLOCK A 26 VICTORIA LINK
ROUTE 21 CORPORATE PARK, IRENE,
CENTURION,
0062, PRETORIA
T: 086 167 6646 E: adi@adiengineering.co.za W: www.adiengineering.co.za

CLIENT:
TOURISM KWAZULU NATAL

South Africa KWAZULU-NATAL
Zulu Kingdom. *Exceptional*

PROJECT:
NELSON MANDELA CAPTURE SITE

PROJECT STATUS:
TENDER

APPROVED
THE MASTER HELD AT ADI ENGINEERING BEARS THE ORIGINAL SIGNITURE OF APPROVAL
ECSA NO:

SIGNATURE: NAME: DATE:

DRAWING TITLE:
GRID INLET AND EARTH BERM DETAILS

DRAWING UNITS: MILLIMETER

DATE	SCALE	DESIGNED BY
06/04/2021	AS SHOWN	T.NEZANDONYI

CHECKED BY	DRAWN BY	APPROVED BY
D. GWANGWADZA	N. MASHEGO	T. NEZANDONYI

DRAWING NO	REV
P1808 - CIV - 200 - 06	**TD**

File Path